


17.9±1.0

455±25


# **APPROVAL** ☐ APPROVED, PROCEED WITH FABRICATION ☐ APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS

☐ DISAPPROVED, DO NOT FABRICATE



#### **DIGITAL FLO BOILER WATER/WATER PLATE &** FRAME HEAT EXCHANGER SINGLE WALL

## PIPING AND COMPONENTS HIDDEN TO SHOW CONNECTIONS

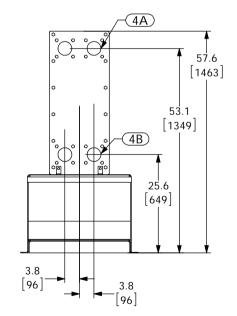

#### PROJECT NAME:

#### TAG:

ITEM	DESCRIPTION	CONNECTION
1	COLD WATER INLET	3" FLG ANSI 150
2	MIXED WATER OUTLET	3" FLG ANSI 150
3	RECIRC WATER INLET	2" NPT
4A	PRIMARY(BOILER) INLET	3" FLG ANSI 150
4B	PRIMARY(BOILER) OUTLET	3" FLG ANSI 150
5	ELECTRICAL PANEL/BRAINSCAN	110VAC @ 1.2A
6	DRV80	3" NPT
7	N.C. ACTUATED BALL VALVE SAFETY SHUT OFF	3" WAFER
8	THERMOMETER (3)	
9	CIP CONNECTION (2)	1-1/2" AND 1" NPT
10	SRV(PRESSURE) PIPE TO DRAIN	1" NPT
11	SRV(CONNECTION FOR USER SUPPLIED T&P)	1-1/2" NPT
	ITEM	MATERIAL
	PIPING	COPPER TYPE "L"
	EXCHANGER PLATE MATL.	T316L SS
	EXCHANGER GASKET MATL.	NITRILE

### NOTE(S):

62.5

1586

(5)

1. ALL DIMENSIONS +/- .5[13] UNLESS OTHERWISE SHOWN

32.5

826

2. COMPLETE ASSEMBLY LEAD FREE COMPLIANT - THE WETTED SURFACE OF THIS PRODUCT CONTACTED BY CONSUMABLE WATER CONTAINS LESS THAN ONE QUARTER OF ONE PERCENT (0.25%) OF LEAD BY WEIGHT.

79.3


[2013]

3. PACKAGE INCLUDES ALL REQUIRED INLET CHECK VALVES AND STRAINERS ON DOMESTIC SIDE.

3.3

83

4. DRV, SAFETY SHUT OFF AND ELECTRICAL PANEL ARE PREWIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.



**SALES** 

ARMSTRONG INTERNATIONAL Copyright (C) 2010 ARMSTRONG INTERNATIONAL, INC

DF90WE80BS 3 FLG 3 FLG 2 NPT CPR

CONFIG# (C-XXXXXX) 02/26/2013 MATERIAL

SHEET 1 OF 1 DWG. D5XXXXX

39.6±1.0 [1006±25]

13.7

348

50.8±1.0 [1290±25]

27.1±1.0

[689±25]

52.4±1.0 1331±25