



APPROVAL

- $\ \square$ APPROVED, PROCEED WITH FABRICATION
- APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS
- ☐ DISAPPROVED, DO NOT FABRICATE

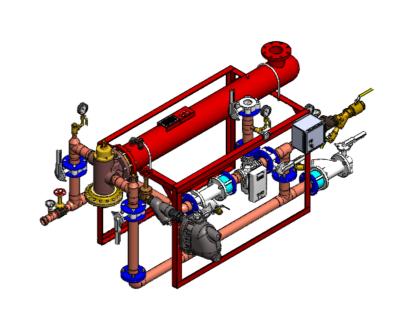

FLO-RITE-TEMP

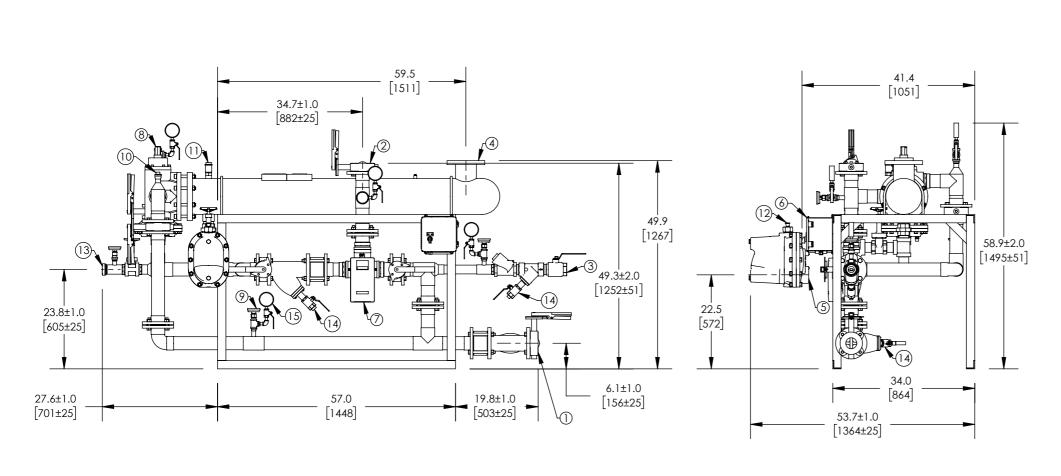

ITEM	DESCRIPTION		CONNECTION	
1	COLD WATER INLET		3" FLG ANSI 150	
2	MIXED WATER OUTLET		3" FLG ANSI 150	
3	RECIRC WATER INLET		2" NPT	
4	STEAM INLET		4" FLG ANSI 150	
5	CONDE	NSATE OUTLET	2" NPT 20-JD8 F&T	
6	ELECTR	CAL PANEL	110 VAC @0.7A	
7	DRV80		3" NPT	
8	CONTROL VALVE		3" NPT	
9	THERMOMETER(4)		1/2" NPT	
10	CIP CONNECTION(2)		1" NPT	
11	AIR VENT		3/4" NPT	
12	VACUUM BREAKER		1/2" NPT	
13	BYPASS TO DRAIN		2" NPT	
14	BLOW DOWN(3)		1" NPT	
15	PRESSU	RE GAUGE (4)	1/4" NPT	
	ITEM		MATERIAL	
	PIPING		COPPER TYPE "L"	
	EXCHANGER SHELL MATL.		CARBON STEEL	
	EXCHANGER TUBE MATL.		COPPER	
\bigcap		ARMSTRONG INTERNATIONAL Copyright © 2010 ARMSTRONG INTERNATIONAL, INC.		

NOTE(S):

- 1. ALL DIMENSIONS +/-0.5 [13] UNLESS OTHERWISE SHOWN.
- 2. COMPLETE ASSEMBLY LEAD FREE COMPLIANT THE WETTED SURFACE OF THIS PRODUCT CONTACTED BY CONSUMABLE WATER CONTAINS LESS THAN ONE QUARTER OF ONE PERCENT (0.25%) OF LEAD BY WEIGHT.
- 3. PACKAGE INCLUDES ALL REQUIRED INLET CHECK VALVES, ISOLATION VALVES, AND STRAINERS ON DOMESTIC SIDE.
- 4. DRV AND ELECTRICAL PANEL ARE PREWIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.



FRT8120DW80

DECIMAL .XXXX ± .0005 .XXX ± .005 .XX ± .015 .XX ± .015 .XX

.010 DRAWN RELEASED

NAME

DATE 5/18/2015

MATERIAL

CWF55983

SHEET 1 OF 1

^v с | SALES