




APPROVAL

- $\ \square$ APPROVED, PROCEED WITH FABRICATION
- APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS
- ☐ DISAPPROVED, DO NOT FABRICATE



FLO-RITE-TEMP

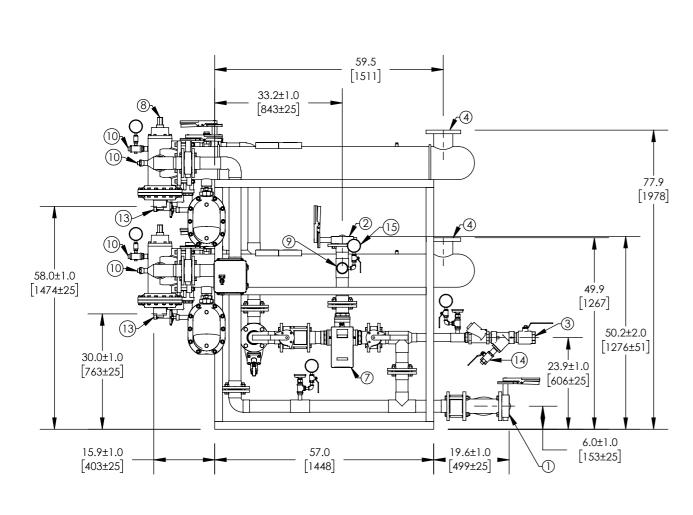


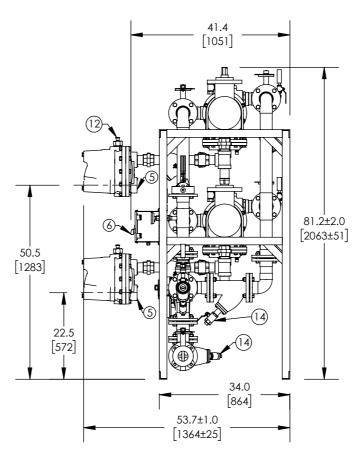

ITEM	DESCRIPTION	CONNECTION
1	COLD WATER INLET	3" FLG ANSI 150
2	MIXED WATER OUTLET	3" FLG ANSI 150
3	RECIRC WATER INLET	2" NPT
4	STEAM INLET (2)	4" FLG ANSI 150
5	CONDENSATE OUTLET (2)	2" NPT 20-JD8 F&T
6	ELECTRICAL PANEL	110 VAC @0.7A
7	DRV80	3" NPT
8	CONTROL VALVE (2)	3" NPT
9	THERMOMETER(5)	1/2" NPT
10	CIP CONNECTION(4)	1" NPT
11	AIR VENT (2)	3/4" NPT
12	VACUUM BREAKER (2)	1/2" NPT
13	BYPASS TO DRAIN (2)	2" NPT
14	BLOW DOWN(3)	1" NPT
15	PRESSURE GAUGE (5)	1/4" NPT
	ITFAA	AAATEDIAI
	ITEM	MATERIAL
	PIPING EXCHANGER SHELL MATL.	COPPER TYPE "L" CARBON STEEL
	EXCHANGER SHELL MAIL. EXCHANGER TUBE MAIL.	CARBON STEEL COPPER
		ONG INTERNATIONAL

NOTE(S):

- 1. ALL DIMENSIONS +/-0.5 [13] UNLESS OTHERWISE SHOWN.
- 2. COMPLETE ASSEMBLY LEAD FREE COMPLIANT THE WETTED SURFACE OF THIS PRODUCT CONTACTED BY CONSUMABLE WATER CONTAINS LESS THAN ONE QUARTER OF ONE PERCENT (0.25%) OF LEAD BY WEIGHT.
- 3. PACKAGE INCLUDES ALL REQUIRED INLET CHECK VALVES, ISOLATION VALVES, AND STRAINERS ON DOMESTIC SIDE.
- 4. DRV AND ELECTRICAL PANEL ARE PREWIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.

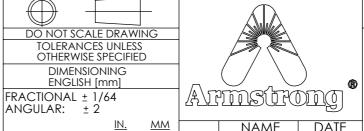

ARMSTRONG INTERNATIONAL Copyright \bigcirc 2010 armstrong international, inc.

FRT8120DWP80

DECIMAL .XXXX ± .0005 .XXX ± .005 .XX ± .015 .XX ± .015 .XX .010

DRAWN RELEASED

NAME

DATE 5/18/2015

MATERIAL

CWF55983

^v с |

SALES

SHEET 1 OF 1