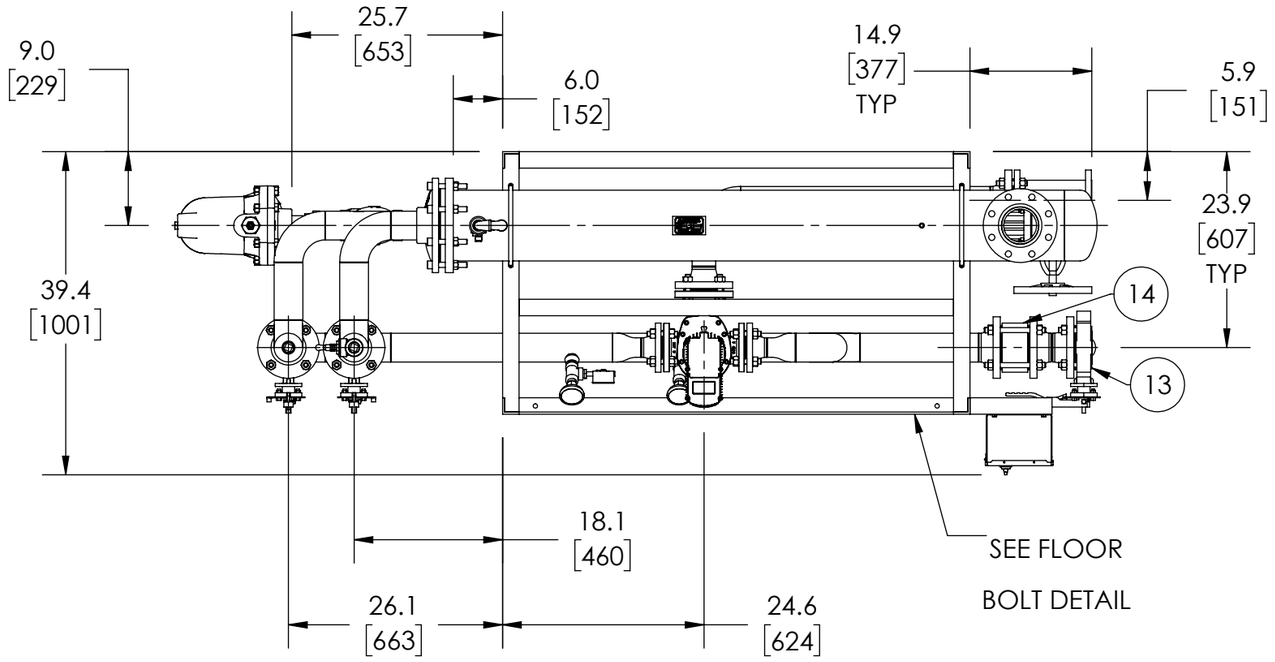

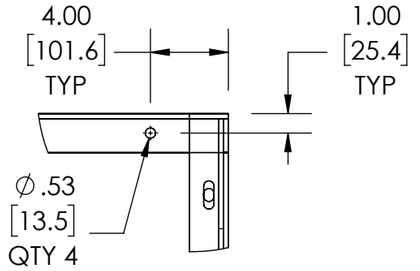

FLOOR BOLT

LOCATION

APPROVAL

BY:_____ DATE:_____

- ☐ APPROVED, PROCEED WITH FABRICATION
- ☐ APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS
- ☐ DISAPPROVED, DO NOT FABRICATE

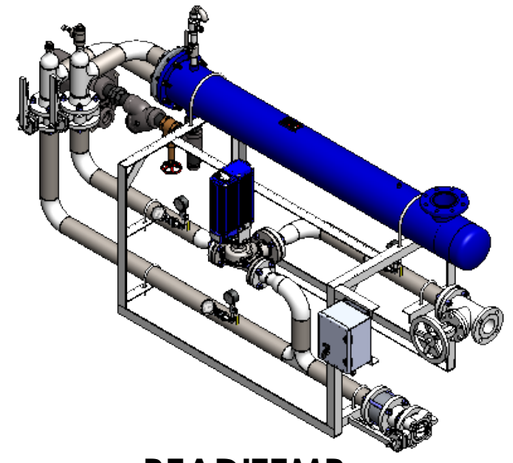

READITEMP

ITEM NO.	DESCRIPTION	CONNECTION
1	COLD WATER INLET	3" FLG ANSI 150
2	MIXED OUTLET	3" FLG ANSI 150
3	STEAM INLET	4" FLG ANSI 150
4	CONDENSATE OUTLET	2" NPT 20-JD8 F&T
5	ELECTRICAL PANEL	120/240 VAC 1.8/.9A
6	E50WR	2" FLG ANSI 150
7	THERMOMETER (3)	1/2" NPT
8	PRESSURE GAUGE (3)	1/4" NPT
9	CIP CONNECTION (2)	1" NPT
10	SRV (PRESSURE) PIPE TO DRAIN	1/4" NPT
11	AIR VENT	3/4" NPT
12	VACUUM BREAKER	1/2" NPT
13	BUTTERFLY VALVE (3)	3" FLG ANSI 150
14	CHECK VALVE	3" FLG ANSI 150
15	GLOBE VALVE	3" FLG ANSI 150

ITEM	MATERIAL
PIPING	316 STAINLESS STEEL
STAND	304 STAINLESS STEEL
EXCHANGER TUBE MATERIAL	ADMIRALTY BRASS

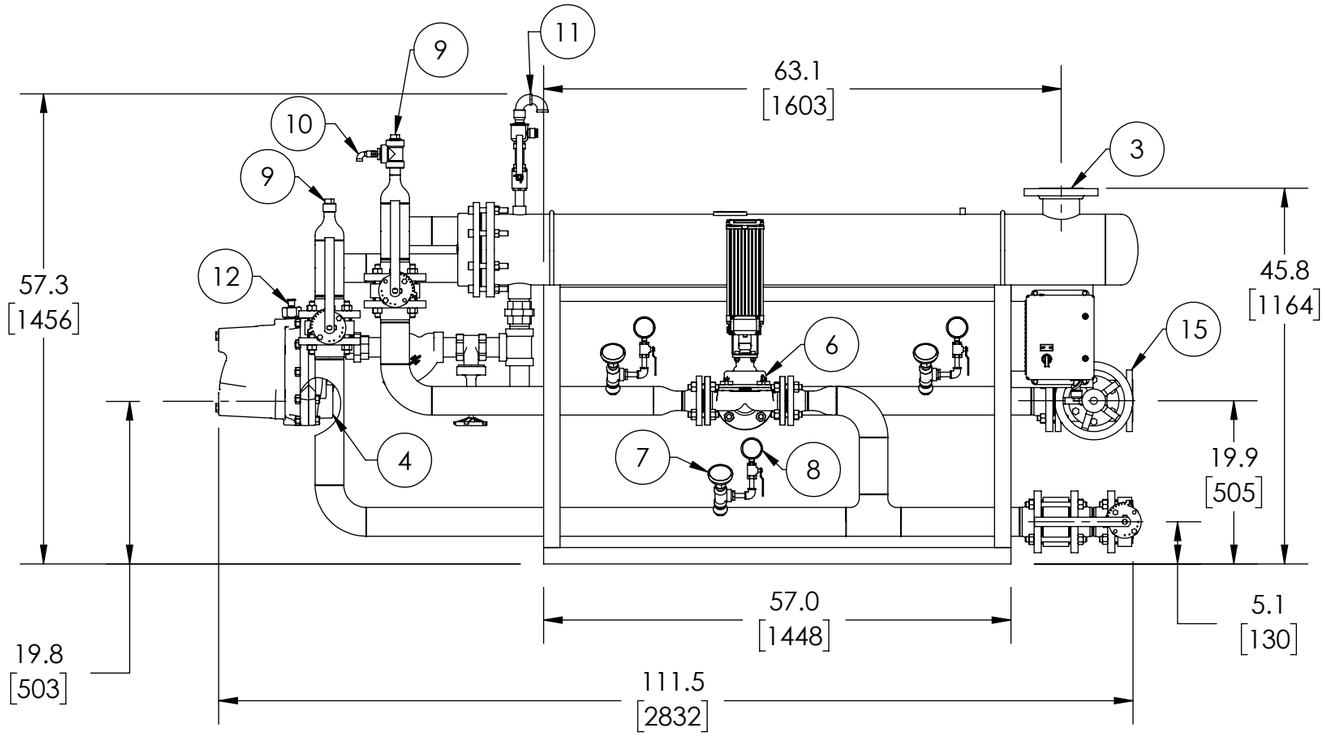

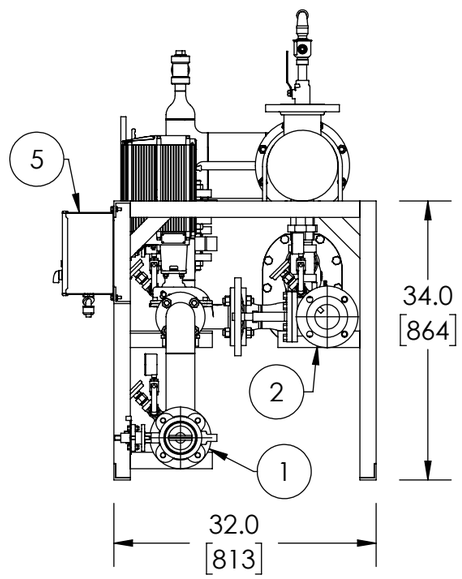

NOTE(S):

1. ALL DIMENSIONS +/-1.0 [25] UNLESS OTHERWISE SHOWN.
2. EMECH AND POWER SUPPLY ARE PREWIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.

DO NOT SCALE DRAWING
TOLERANCES UNLESS OTHERWISE SPECIFIED
DIMENSIONING ENGLISH [mm]
FRACTIONAL ± 1/64
ANGULAR: ± 2

		IN.	MM
DECIMAL	.XXXX ±	.0005	-----
	.XXX ±	.005	.010
	.XX ±	.015	.10
	.X	----------	.3

Armstrong®

	NAME	DATE
DRAWN	CFG	5/18/2015
RELEASED		

ARMSTRONG INTERNATIONAL

Copyright © 2010 ARMSTRONG INTERNATIONAL, INC.

RT812050G

MATERIAL | SHEET 1 OF 1

REV | SALES