#### DIGITAL MIXING CENTER

The Digital Mixing Center (DMC) is designed to be the primary water temperature controller in a recirculating hot water system. DMC80-80-80 features three digital recirculation valves (The Brain®) piped in parallel.


Engineered exclusively for continuously recirculated hot water systems, DMC80-80-80 improves system performance and safety by delivering a consistent preset temperature to the points of use.

Innovative digital technology resists "temperature creep" during periods of zero system demand which eliminates the requirement for manual throttling valves, supplementary RTD or a temperature actuated switch to control the pump.

Energy efficient, low temperature loss systems can be implemented by the ability of DMC80-80-80 to operate with a system return differential of just 1° F below set point.

User safety and overall system health is maintained by a series of programmable temperature alerts, onboard operational self-diagnostics, and a thermal disinfection option.

DMC80-80-80 is a complete pre-piped assembly inclusive of isolation valves, check valves, strainers, thermometers, and pressure gauges, and is provided with five connection points for simplified installation.

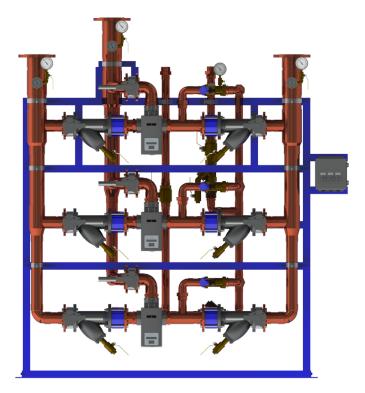

The Brain® Digital Mixing Center DMC80-80-80

DMC80-80-80 Performance Chart: Pressure Drop (in PSIG) to Flow Rate (in GPM)							
DRV80	Pressure Drop (PSIG)				Minimum System	Minimum Flow Rate	C
3 units	5	10	15	20	Draw-Off	Willillialli Flow hate	C <sub>v</sub>
GPM	282	399	489	564	0 GPM	10 GPM (per valve)	126

DMC80-80-80 Performance Chart: Pressure Drop (in BARG) to Flow Rate (in LPM)							
DRV80	Pressure Drop (BARG)				Minimum System	Minimum Flow Rate	V
3 units	0.3	0.7	1.0	1.4	Draw-Off	Willilliulli Flow hate	K <sub>v</sub>
LPM	1067.4	1501.5	1851	2135.1	0 LPM	38 LPM (per valve)	108



## **TECHNICAL SPECIFICATIONS**

General						
Protection	NEMA 3S, IPX4					
Ambient Temperature	Minimum Ambient Temperature: 35°F (2°C)  Maximum Ambient Temperature: 122°F (50					
Ambient Humidity	95% Non-Condensing					
Installation Environment	Suitable for indoor use only					
Materials	Valve: Stainless Steel, Electronics Module: PC / ABS					
Safety	Seven fail-safe cold triggers supported by integral self-diagnostics and a programmable over-temp limit					
Connections						
DRV Connections	3" NPT					
Hot & Cold Water Inlet Connections	5" Flange ANSI 150					
Mixed Water Outlet Connections	Outlet Connections 5" Flange ANSI 150					
Recirc. Mixed Return Connection	2" SWT					
Return to Heater Connection	2" SWT					
Pressures						
Inlet Supply Pressures	Max. Pressure (DRV): 200 psi / 1379 kPA = 13.8 bar	Minimum Pressure: 20 psi / 138 kPA = 1.5 bar				
inlet Supply Plessures	Max. Pressure (Manifold): 150 psi / 1034 kPA = 10.3 bar	Willimum Pressure. 20 psi/130 kPA – 1.3 bdi				
Supply Pressure Differential	Nominally equal					
Temperatures						
Hot Water Supply Temperature	Maximum Inlet Hot Supply Temperature: 185°F (85°C)	Minimum Inlet Hot Supply Temperature: 5°F (2°C) above DRV set point				
Cold Water Supply Temperature	Minimum Inlet Cold Supply Temperature: 35.6°F (2°C)	)				
Min. Recirculation Temperature Loss	1°F ( ≤ 1°C)					
Min. Continuous Recirculation Flow						
Recirculation Circuit						
Minimum Distance to First Outlet 25 ft (7.6 m)						
Electrical						
Power Supply	120 - 240V AC - 50/60 Hz					
Supply Fuse / Circuit Breaker	Grounding required (Switched Type 3 Amp - no plug; 15 Amp Grounding-type receptacle - plug)					
Battery	Qty (2) CR - P2 6V					
Configurable Settings						
Set Point Range	81°F to 158°F (27°C to 70°C)					
High Temperature Alert	Minimum of 2°F (1°C) above DRV set point					
High Temperature Error	igh Temperature Error 5°F (2°C) above DRV set point					
Thermal Disinfection Temperature	Programmable range of 158°F to 185°F (70°C to 85°C)	)				
Thermal Disinfection Set-Up	Disinfection Duration: ≤ 100 minutes Disinfection Cool Down Duration: ≤ 30 hours					
Units of Measure	Degrees Fahrenheit (°F) or Degrees Celsius (°C)					

Continued on next page





## **TECHNICAL SPECIFICATIONS**

Connectivity	
Modbus RTU	RS-485 port for connection to building automation systems (BAS) operating on Modbus RTU protocol
SAGE® Module	RS-485 port for connection to SAGE® module with Modbus TCP, BACnet TCP/IP, BACnet MSTP, or LonWorks protocessor  Note: Protocessors for other BAS protocols may be available upon request
SAGE® Subscription	Real-time monitoring, recording, and documentation dashboard for Armstrong Hot Water Systems
Standards and Approvals	
ASSE 1017	Certified & Listed
CSA B125.3-11	Compliant
UL	Listed
CE	Listed





#### WRITTEN SPECIFICATIONS

Category: The Brain®

Type: Digital Mixing Center

Model: Model DMC80-80-80

Part 1 - GENERAL

#### 1.0 Digital Mixing Center

- 1.1 Three (3) Digital Recirculation Valves (DRV) shall be supplied pre-piped and pressure-tested as a lead-free Digital Mixing Center (DMC) complete with hot water inlet, cold water inlet, mixed water outlet, recirculation return inlet, and return to heater connections.
- 1.2 DMC80-80-80 shall comprise of (3) DRV80 pre-wired to an electrical panel, isolation valves, strainers, check valves, thermometers, and pressure gauges assembled on Type L copper with hot water bypass securely mounted on a carbon steel frame with industrial grade enamel paint.

#### 2.0 Digital Recirculation Valve

- 2.1 DRV shall have four thermistors integral of the mixing valve body that measure the cold water and recirculation return inlet, hot water inlet, mixed water outlet, and over-temp safety measures.
- 2.2 DRV mixing valve body shall be of 316L stainless steel, mixing valve proportioner of 316L stainless steel, and a NEMA 3S electronics enclosure.
- 2.3 DRV80 shall have 3" inlet and outlet connections that will deliver 133 gpm @ 10 psid.
- 2.4 DRV shall be capable of + / 2°F control during high, low, or extended periods of zero demand on the system, with a continuous recirculation of >10 gpm. Temperature control shall be achieved without aquastat-like control of the recirculation pump.
- 2.5 DRV setpoint shall be configured by the factory to customer specification. DRV shall be field adjustable.

#### 3.0 DRV80 shall have the following operational specifications:

- 3.1 + / 2°F (1°C) water temperature control
- 3.2 1°F minimum mixed water outlet to recirculated return inlet differential (system temperature loss)
- 3.3 Minimum continuous recirculation of 10 gpm
- 3.4 Automatic shutoff of hot water upon cold water inlet supply failure
- 3.5 Automatic shutoff of hot water flow in the event of a power failure
- 3.6 Programmable setpoint range of 81°F 158°F (27°C 70°C)
- 3.7 Programmable thermal disinfection mode
- 3.8 Programmable 1st level hi/lo temperature alert display
- 3.9 Programmable temperature error level for safety shutdown

#### 4.0 DRV80 shall have the following connectivity specifications:

- 4.1 Modbus RS-485 port for connection to building automation system (BAS) operating on Modbus RTU protocol
- 4.2 RS-485 port for connection to SAGE® module with Modbus TCP, BACnet TCP/IP, BACnet MSTP, or LonWorks protocessor
  - Note: Protocessors for other BAS protocols available upon request

### 5.0 DRV shall be certified to ASSE 1017, UL listed, and conform to CSA B125.

#### 6.0 Warranty

- 6.1 DRV shall have a 5-year warranty on all components, with the exception of batteries and O-rings.
- 6.2 Pre-piped DMC components shall have a 2-year warranty from date of installation, but not longer than 27 months from date of shipment.



#### CONNECTIVITY



### The Brain® and SAGE®

SAGE® works seamlessly with The Brain® as it analyzes data to track behavior and performance as an integral component of a hot water system operation protocol which complies with a standard of care.

The Brain® and every derivative assembly is supplied with an integral RS-485 serial port. This port provides a direct connection to Building Automation Systems that operate on a **Modbus RTU** protocol.

The RS-485 port is also deployed for direct connection to an optionally supplied Building System (BS) Module.

# **SAGE®** Options

**SAGE®** for Building Automation Systems (BAS) - BS Module available with BAS specific ProtoCessor cards for connection to systems which operate on **Modbus TCP**, **BACnet™ TCP/IP**, **BACnet™ MSTP**, or **LonWorks™** protocols.

**SAGE®** for Mobile Connectivity - Featuring smart hot water system dashboard monitoring, secure remote programming, multi-location view, temperature and system diagnostic alerts, with unlimited digital documentation and automated report generation.

Mobile connectivity may be enabled by a customer activated no-term subscription.




### **Optional Building System (BS) Module**

Adding a suffix "BS" to The Brain® DRV (example: DRV25<u>BS)</u> will automatically add SAGE®, the supplemental hardware and software required to maximize the connectivity features of Armstrong digital technology.






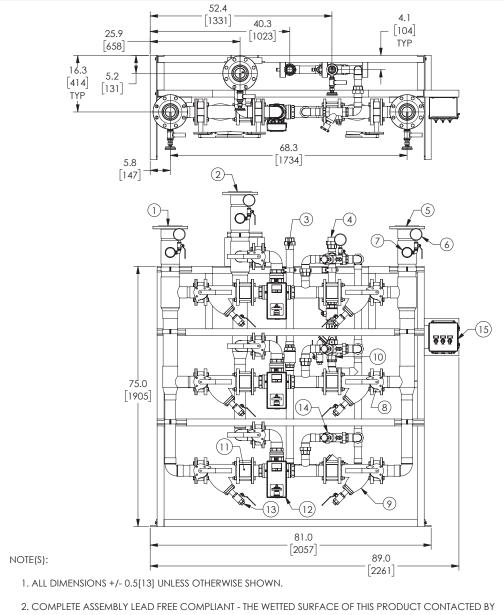


# **APPROVAL**

BY:\_

- ☐ APPROVED, PROCEED WITH FABRICATION
- APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS
- ☐ DISAPPROVED, DO NOT FABRICATE

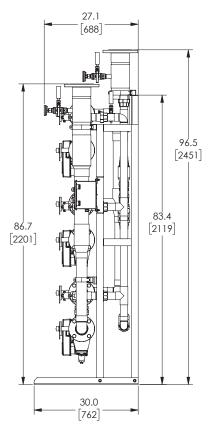



#### PROJECT NAME:

TAG:

ITEM NO.	DESCRIPTION	QTY	CONNECTION
1	HOT WATER INLET	1	5" FLG ANSI 150
2	MIXED WATER OUTLET	1	5" FLG ANSI 150
3	RETURN TO HEATER	1	2" SWT
4	MIXED RETURN INLET	1	2" SWT
5	COLD WATER INLET	1	5" FLG ANSI 150
6	PRESSURE GAUGE	4	
7	THERMOMETER	4	
8	BUTTERFLY VALVE	9	
9	STRAINER	7	
10	SPRING CHECK VALVE	1	
11	WAFER CHECK VALVE	6	
12	DRV80	3	3" NPT
13	BLOW DOWN	7	
14	BALANCING VALVE	3	
15	ELECTRICAL PANEL	1	110 VAC
15	ELECTRICAL PANEL	1	110 VAC

ITEM MATERIAL **PIPING** COPPER TYPE "L"

ARMSTRONG INTERNATIONAL Copyright (C) 2010 ARMSTRONG INTERNATIONAL, INC. DMC80-80-80 5 FLG 5 FLG 2 SWT CPR

Armstrong

DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE SPECIFIED DIMENSIONING ENGLISH [mm] FRACTIONAL ± 1/64 ANGULAR: ± 2

.XXXX ± .0005 .XXX ± .005 .XX ± .015 .X .010

NAME Jega Theesan 03/05/2015MATERIAL DRAWN

SHEET 1 OF 1 CN67755 REVQ DWG. SALES

- CONSUMABLE WATER CONTAINS LESS THAN ONE QUARTER OF ONE PERCENT (0.25%) OF LEAD BY WEIGHT.
- 3. PACKAGE INCLUDES ALL REQUIRED INLET CHECK VALVES AND STRAINERS ON DOMESTIC SIDE.
- 4. DRV AND ELECTRIC PANEL ARE PRE-WIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.
- 5. REFERENCE ARMSTRONG PART NO. D40819