INSTANTANEOUS WATER HEATER with THE BRAIN® MODEL DRV80


Flo-Rite-Temp® Pre-Piped for Digital Control of Recirculating Hot Water Systems is a packaged water heating solution inclusive of a shell and tube heat exchanger fitted with an integral control valve for water heating and system temperature control.

The feed forward design instantly determines downstream hot water demand and directs cold water through the heat exchanger. Water is heated above legionella survival temperatures with constant pressure steam and then blended with a proportional amount of cold water to set point temperature.


Engineered exclusively for continuously recirculated hot water systems, Flo-Rite-Temp® includes The Brain® Digital Recirculation Valve to improve system performance and safety by delivering a consistent pre-set temperature to the points of use.

User safety and overall system health is maintained by a series of programmable temperature alerts, onboard operational self-diagnostics, and a thermal disinfection option.

Flo-Rite-Temp® is available with single wall or double wall heat exchangers in four standard sizes, with parallel and redundant configurations available. Flo-Rite-Temp® can be customized to suit specific application needs.

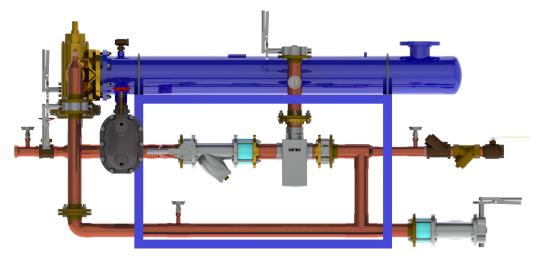

Flo-Rite-Temp® FRT812080 Single Wall Instantaneous Water Heater

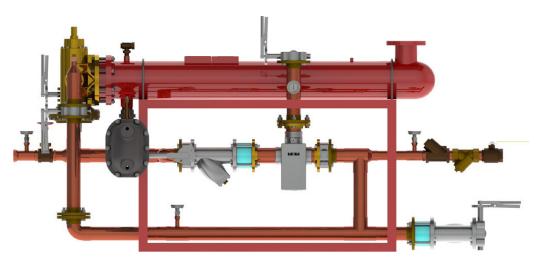

Flo-Rite-Temp® FRT8120DW80 Double Wall Instantaneous Water Heater





TECHNICAL SPECIFICATIONS - SIZING

FRT812080 and FRT8120DW80 Water and Steam Capacities - Imperial Units									
Inlet Temperature	Set Temperature	Hot Water Capacities in GPM Steam Pressure			Steam Capacities in lb/hr				
					Steam Pressure				
, , , , , , , , , , , , , , , , , , ,		2 psig	5 psig	10 psig	15 psig	2 psig	5 psig	10 psig	15 psig
	120°F	142	145	145	145	5,680	6,160	6,760	7,160
	130°F	112	122	136	145	5,040	5,490	6,120	6,705
40°F	140°F	88	97	109	120	4,400	4,850	5,450	6,000
	160°F	69	83	89	95	4,140	4,980	5,340	5,700
	180°F	43	47	52	59	3,010	3,290	3,640	4,130
	120°F	145	145	145	145	5,740	6,090	6,580	7,035
50°F	130°F	127	138	145	145	5,080	5,520	6,120	6,760
	140°F	99	108	121	134	4,455	4,860	5,445	6,030
	160°F	76	90	95	102	4,180	4,950	5,225	5,610
	180°F	49	55	63	72	3,185	3,575	4,095	4,680
60°F	130°F	145	145	145	145	5,1 10	5,565	6,090	6,510
	140°F	111	123	137	145	4,440	4,920	5,480	6,080
OU F	160°F	85	99	104	115	4,250	4,950	5,200	5,750
	180°F	59	67	80	90	3,540	4,020	4,800	5,400

	FRT812080 and FRT8120DW80 Water and Steam Capacities - Metric Units								
Inlet Temperature	Set Temperature		Hot Water Ca	pacities in m³			Steam Capac	ities in kg/hr	
		Steam Pressure			Steam Pressure				
		0.14 bar	0.35 bar	0.7 bar	1 bar	0.14 bar	0.35 bar	0.7 bar	1 bar
	49°C	32.2	32.9	32.9	32.9	2,576	2,794	3,066	3,248
	54°C	25.4	27.7	30.9	32.9	2,286	2,490	2,776	3,041
4°C	60°C	20.0	22.0	24.7	27.2	1,996	2,200	2,472	2,722
	71°C	15.6	18.8	20.2	21.6	1,878	2,259	2,422	2,585
	82°C	9.7	10.7	11.8	13.4	1,365	1,492	1,651	1,873
	49°C	32.2	32.2	32.2	32.2	2,603	2,762	2,985	3,191
50°C	54°C	28.8	31.3	32.2	32.2	2,304	2,504	2,776	3,066
	60°C	22.5	24.5	27.5	30.4	2,021	2,204	2,470	2,735
	71°C	17.2	20.4	21.6	23.1	1,896	2,245	2,370	2,545
	82°C	11.1	12.5	14.3	16.3	1,445	1,622	1,857	2,123
	54°C	32.2	32.2	32.2	32.2	2,318	2,524	2,762	2,953
C000	60°C	25.2	27.9	31.1	32.2	2,014	2,232	2,486	2,758
60°C	71°C	19.3	22.5	23.6	26.1	1,928	2,245	2,359	2,608
	82°C	13.4	15.2	18.1	20.4	1,606	1,823	2,177	2,449



TECHNICAL SPECIFICATIONS

General						
Protection (DRV80	Valve)	NEMA 3S, IPX4				
Ambient Temperature		Minimum Ambient Temperature: 35°F (2°C)	Maximum Ambient Temperature: 122°F (50°C)			
Ambient Humidity		95% Non-Condensing				
Installation Environr	ment	Suitable for indoor use only				
Safety (DRV80 Valv	re)	Seven fail-safe cold triggers supported by integral se	elf-diagnostics and a programmable over-temp limit			
Materials	<u> </u>		and a programmable even temp imme			
DRV80 Valve		Valve: Stainless Steel, Electronics Module: PC / ABS				
FRT Control Valve		Bronze				
Heat Exchanger Sh	ell	Carbon steel, ASTM SA-106, Gr. B, ASME "U" stamped with Type 316 stainless steel two-pass head				
Heat Exchanger	Single Wall	Admiralty brass tubes; 5/8" OD x 16 BWG wall				
Tube Bundle	Double Wall	Copper tubes; 5/8" OD inner with 3/4" OD grooved of	outer			
Heat Exchanger	Single Wall	Lead-free brass				
Tube Sheets	Double Wall	Brass on water side; Steel on steam side				
Tube Bundle End Ca	p (Single Wall ONLY)	Lead-free brass				
Integral Supply Pipe	e Work	Lead-free brass / Type L copper				
Integral Valves and	Fittings	Lead-free brass or bronze				
Condensate Piping		Cast iron and carbon steel				
Connections						
DRV80 Valve Conn	ections	3" NPT Female Connections				
	Cold Water Inlet	3" Class 150 Flange Connection				
Water Side	Recirc. Return Line	2" NPT Connection				
Mixed Water Outlet		3" Class 150 Flange Connection				
Steam Side	Steam Inlet	4" Class 150 Flange Connection				
Steam Side	Condensate Outlet	2" NPT Connections (Armstrong Steam Trap 20-JD8 F&T)				
Pressures						
Water Inlet Supply Pressures		Maximum Water Pressure: 150 psig (10 barg)	Minimum Pressure: 20 psig (1.5 barg)			
Steam Inlet Sunnly	Praesurae	Maximum Allowable Steam Pressure: 150 psig (10 barg)				
Steam Inlet Supply Pressures		Maximum Operating Steam Pressure: 15 pisg (1 barg)				
Temperatures						
Cold Water Supply Temperature		Minimum Inlet Cold Supply Temperature: 34°F (1.1°C)				
Min. Recirculation Temperature Loss		1°F (≤1°C)				
Min. Continuous Red	circulation Flow	10 GPM (38 LPM)				
Electrical						
Power Supply		120 - 240V AC - 50/60 Hz				
Control Circuit Fuse		3 A				
Supply Fuse / Circuit Breaker		Grounding required (Switched Type 3 Amp - no plug; 15 Amp Grounding-type receptacle - plug)				
Battery (DRV80 Valve)		Qty (2) CR - P2 6V				

Continued on next page





TECHNICAL SPECIFICATIONS

Configurable Settings						
Set Point Range	81°F to 158°F (27°C to 70°C)					
High Temperature Alert	Minimum of 2°F (1°C) above DRV set point	Minimum of 2°F (1°C) above DRV set point				
High Temperature Error	5°F (2°C) above DRV set point					
Thermal Disinfection Temperature	Programmable range of 158°F to 185°F (70°C to 85°C)					
Thermal Disinfection Set-Up	Disinfection Duration: ≤ 100 minutes	Disinfection Cool Down Duration: ≤ 30 hours				
Units of Measure	Degrees Fahrenheit (°F) or Degrees Celsius (°C)					
Connectivity						
Modbus RTU	RS-485 port for connection to building automation systems (BAS) operating on Modbus RTU protocol					
SAGE® Module	RS-485 port for connection to SAGE® module with Modbus TCP, BACnet TCP/IP, BACnet MSTP, or LonWorks protocessor Note: Protocessors for other BAS protocols may be available upon request					
SAGE® Subscription	Real-time monitoring, recording, and documentation dashboard for Armstrong Hot Water Systems					
Standards and Approvals						
ASSE 1017	Certified & Listed					
CSA B125.3-11	Compliant					
UL	Listed					
CE	Listed					





WRITTEN SPECIFICATIONS

Category: Steam to Water Heater with Shell and Tube Heat Exchanger

Type: Flo-Rite-Temp® for Digital Control of Recirculating Systems (with The Brain®)

Model: FRT812080 and FRT8120DW80

Part 1 - GENERAL

1.0 Flo-Rite-Temp® FRT812080 and FRT8120DW80 Overview

- 1.1 The assembly shall be pre-piped steam to water shell and tube heater with performance matched components and pressure-tested before delivery.
 - 1.1.1 FRT812080 shall be of single wall construction with straight admiralty brass tubes expanded into naval brass tube sheets with a bolted end cover.
 - 1.1.2 FRT8120DW80 shall be of double wall construction with 5/8" copper inner tube, 3/4" ID grooved copper outer tube expanded into steel (steam side) and brass (water side) tube sheets.

Heat exchanger will be fixed on one end of the shell and free-floating on the opposite end designed and manufactured in accordance with ASME Code Section VIII.

2.0 Digital Recirculation Valve

- 2.1 Temperature controller (DRV) shall be digital using integrated circuit board technology designed to deliver blended water economically at a safe, accurate temperature for sanitary use in recirculated hot water systems. The DRV shall have a 2-line, 16-character display of delivered temperature with the option of °F or °C. Display also shows the error codes and alarm conditions. DRV shall be compliant with ASSE Standard 1017 and CSA B125, UL listed, and so certified and identified.
- 2.2 DRV80 requires a minimum continuous recirculation of 10 GPM.

3.0 FRT812080 and FRT8120DW80 Assembly

- 3.1 The assembly shall comprise of domestic side check valves, strainers, DRV, thermometers, ball valves, safety shut-off valve, and a shell and tube heat exchanger, pre-piped with Type L copper on a carbon steel frame with industrial grade enamel paint.
- 3.2 Complete assembly shall be lead-free compliant.
- 3.3 Steam pressure on the system to be no more than 15 psig. Designed to generate 165 GPM with a 40°F entering cold water temperature, a 140°F mixed water set point utilizing 15 psig at a maximum of 8,741 lbs/hr.

4.0 FRT812080 and FRT8120DW80 shall have the following operational specifications:

- 4.1 $+/-2^{\circ}$ F (1° C) water temperature control
- 4.2 1° F minimum mixed water outlet to recirculated return inlet differential (system temperature loss)
- 4.3 Automatic shutoff of hot water upon cold water inlet supply failure
- 4.4 Automatic shutoff of hot water flow in the event of a power failure
- 4.5 Programmable setpoint range of 81°F 158° F (27°C 70° C)
- 4.6 Programmable thermal disinfection mode
- 4.7 Programmable 1st level hi/lo temperature alert display
- 4.8 Programmable temperature error level for safety shutdown
- 4.9 LCD display that indicates set point temperature, delivered temperature, error codes and alarm conditions
- 4.10 Isolation valves and clean-in-place connections to chemically clean heat exchanger without disassembly
- 4.11 1/4" domestic side pressure relief pop-off valve with 165 psig (11.4 barg) crack pressure, self-seating

Continued on next page





WRITTEN SPECIFICATIONS

- 5.0 Water heater assembly shall have the following connectivity specifications:
 - 5.1 MODBUS RS-485 port for connection to building automation system (BAS) operating on MODBUS RTU protocol
 - 5.2 RS-485 port for connection to SAGE® module with MODBUS TCP, BACnet TCP/IP, BACnet MSTP, or LonWorks protocessor

 Note: Protocessors for other BAS protocols available upon request
- 6.0 DRV shall be certified to ASSE 1017, UL listed, and conform to CSA B125.

7.0 Warranty

- 7.1 Water heater assembly shall have a 2-year warranty from date of installation, but not longer than 27 months from date of shipment.
- 7.2 DRV shall have a 5-year warranty on all components with the exception of batteries and O-rings.





CONNECTIVITY



The Brain® and SAGE®

SAGE® works seamlessly with The Brain® as it analyzes data to track behavior and performance as an integral component of a hot water system operation protocol which complies with a standard of care.

The Brain® and every derivative assembly is supplied with an integral RS-485 serial port. This port provides a direct connection to Building Automation Systems that operate on a **Modbus RTU** protocol.

The RS-485 port is also deployed for direct connection to an optionally supplied Building System (BS) Module.

SAGE® Options

SAGE® for Building Automation Systems (BAS) - BS Module available with BAS specific ProtoCessor cards for connection to systems which operate on **Modbus TCP**, **BACnet™ TCP/IP**, **BACnet™ MSTP**, or **LonWorks™** protocols.

SAGE® for Mobile Connectivity - Featuring smart hot water system dashboard monitoring, secure remote programming, multi-location view, temperature and system diagnostic alerts, with unlimited digital documentation and automated report generation.

Mobile connectivity may be enabled by a customer activated no-term subscription.




Optional Building System (BS) Module

Adding a suffix "BS" to The Brain® DRV (example: DRV25<u>BS)</u> will automatically add SAGE®, the supplemental hardware and software required to maximize the connectivity features of Armstrong digital technology.






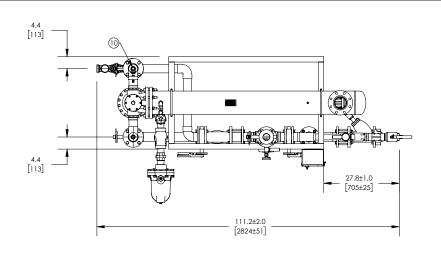



APPROVAL

- ☐ APPROVED, PROCEED WITH FABRICATION
- ☐ APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS
- ☐ DISAPPROVED, DO NOT FABRICATE



FLO-RITE-TEMP

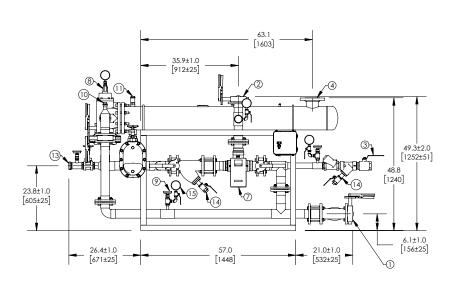




TEM D	ESCRIPTION	CONNECTION
1	COLD WATER INLET	3" FLG ANSI 150
2	MIXED WATER OUTLET	3" FLG ANSI 150
3	RECIRC WATER INLET	2" NPT
4	STEAM INLET	4" FLG ANSI 150
5	CONDENSATE OUTLET	2" NPT 20-JD8 F&T
6	ELECTRICAL PANEL	110 VAC @0.7A
7	DRV80	3" NPT
8	CONTROL VALVE	3" NPT
9	THERMOMETER (4)	1/2" NPT
10	CIP CONNECTION(2)	1" NPT
11	AIR VENT	3/4" NPT
12	VACUUM BREAKER	1/2" NPT
13	BYPASS TO DRAIN	2" NPT 1" NPT
14	BLOW DOWN(3)	
15	PRESSURE GAUGE (4)	1/4" NPT
IT	EM	MATERIAL
PIPING		COPPER TYPE "L"
	EXCHANGER SHELL MATL.	CARBON STEEL
	EXCHANGER TUBE MATL.	ADMIRALTY BRASS

FRT812080


NOTE(S):

- 1. ALL DIMENSIONS +/-0.5 [13] UNLESS OTHERWISE SHOWN.
- COMPLETE ASSEMBLY LEAD FREE COMPLIANT THE WETTED SURFACE OF THIS PRODUCT CONTACTED BY CONSUMABLE WATER CONTAINS LESS THAN ONE QUARTER OF ONE PERCENT (0.25%) OF LEAD BY WEIGHT.
- 3. PACKAGE INCLUDES ALL REQUIRED INLET CHECK VALVES, ISOLATION VALVES, AND STRAINERS ON DOMESTIC SIDE.
- 4. DRV AND ELECTRICAL PANEL ARE PREWIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.



DATE


MATERIAL SHEET 1 OF 1 DRAWN CFG 5/18/2015 RELEASED ′ c SALES

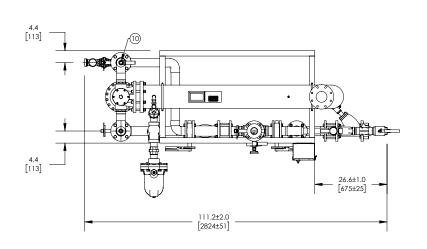


APPROVAL

_____ DA

- ☐ APPROVED, PROCEED WITH FABRICATION
- ☐ APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS
- ☐ DISAPPROVED, DO NOT FABRICATE



FLO-RITE-TEMP

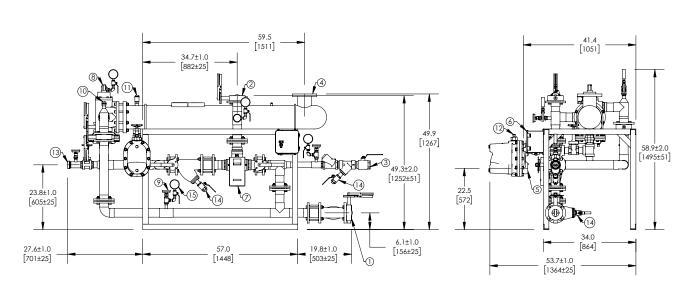

TEM	DESCRIPTION	CONNECTION	
1	COLD WATER INLET	3" FLG ANSI 150	
2	MIXED WATER OUTLET	3" FLG ANSI 150	
3	RECIRC WATER INLET	2" NPT	
4	STEAM INLET	4" FLG ANSI 150	
5	CONDENSATE OUTLET	2" NPT 20-JD8 F&T	
6	ELECTRICAL PANEL	110 VAC @0.7A	
7	DRV80	3" NPT	
8	CONTROL VALVE	3" NPT	
9	THERMOMETER (4)	1/2" NPT	
10	CIP CONNECTION(2)	1" NPT	
11	AIR VENT	3/4" NPT	
12	VACUUM BREAKER	1/2" NPT	
13	BYPASS TO DRAIN	2" NPT	
14	BLOW DOWN(3)	1" NPT	
15	PRESSURE GAUGE (4)	1/4" NPT	
ľ	ΓΕΜ	MATERIAL	
PIPING		COPPER TYPE "L"	
	EXCHANGER SHELL MATL.	CARBON STEEL	
	EXCHANGER TUBE MATL.	COPPER	

NOTE(S):

- 1. ALL DIMENSIONS +/-0.5 [13] UNLESS OTHERWISE SHOWN.
- COMPLETE ASSEMBLY LEAD FREE COMPLIANT THE WETTED SURFACE OF THIS PRODUCT CONTACTED BY CONSUMABLE WATER CONTAINS LESS THAN ONE QUARTER OF ONE PERCENT (0.25%) OF LEAD BY WEIGHT.
- 3. PACKAGE INCLUDES ALL REQUIRED INLET CHECK VALVES, ISOLATION VALVES, AND STRAINERS ON DOMESTIC SIDE.
- 4. DRV AND ELECTRICAL PANEL ARE PREWIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.



C) 2010 ARMSTRONG INTERNAL

FRT8120DW80

DECIMAL .XXXX ± .0005 .010 | .XXX ± .005 .010 | .XX ± .015 .10 | .XX ± .03 .3 | .XX ± .015 .10 | .XX ± .015

NAME DATE

DRAWN CFG 5/18/2015

RELEASED

MATERIAL SHEET 1 OF 1

CWF55983 REV C SALES